


AGECH XL GE1A24/RG1A24

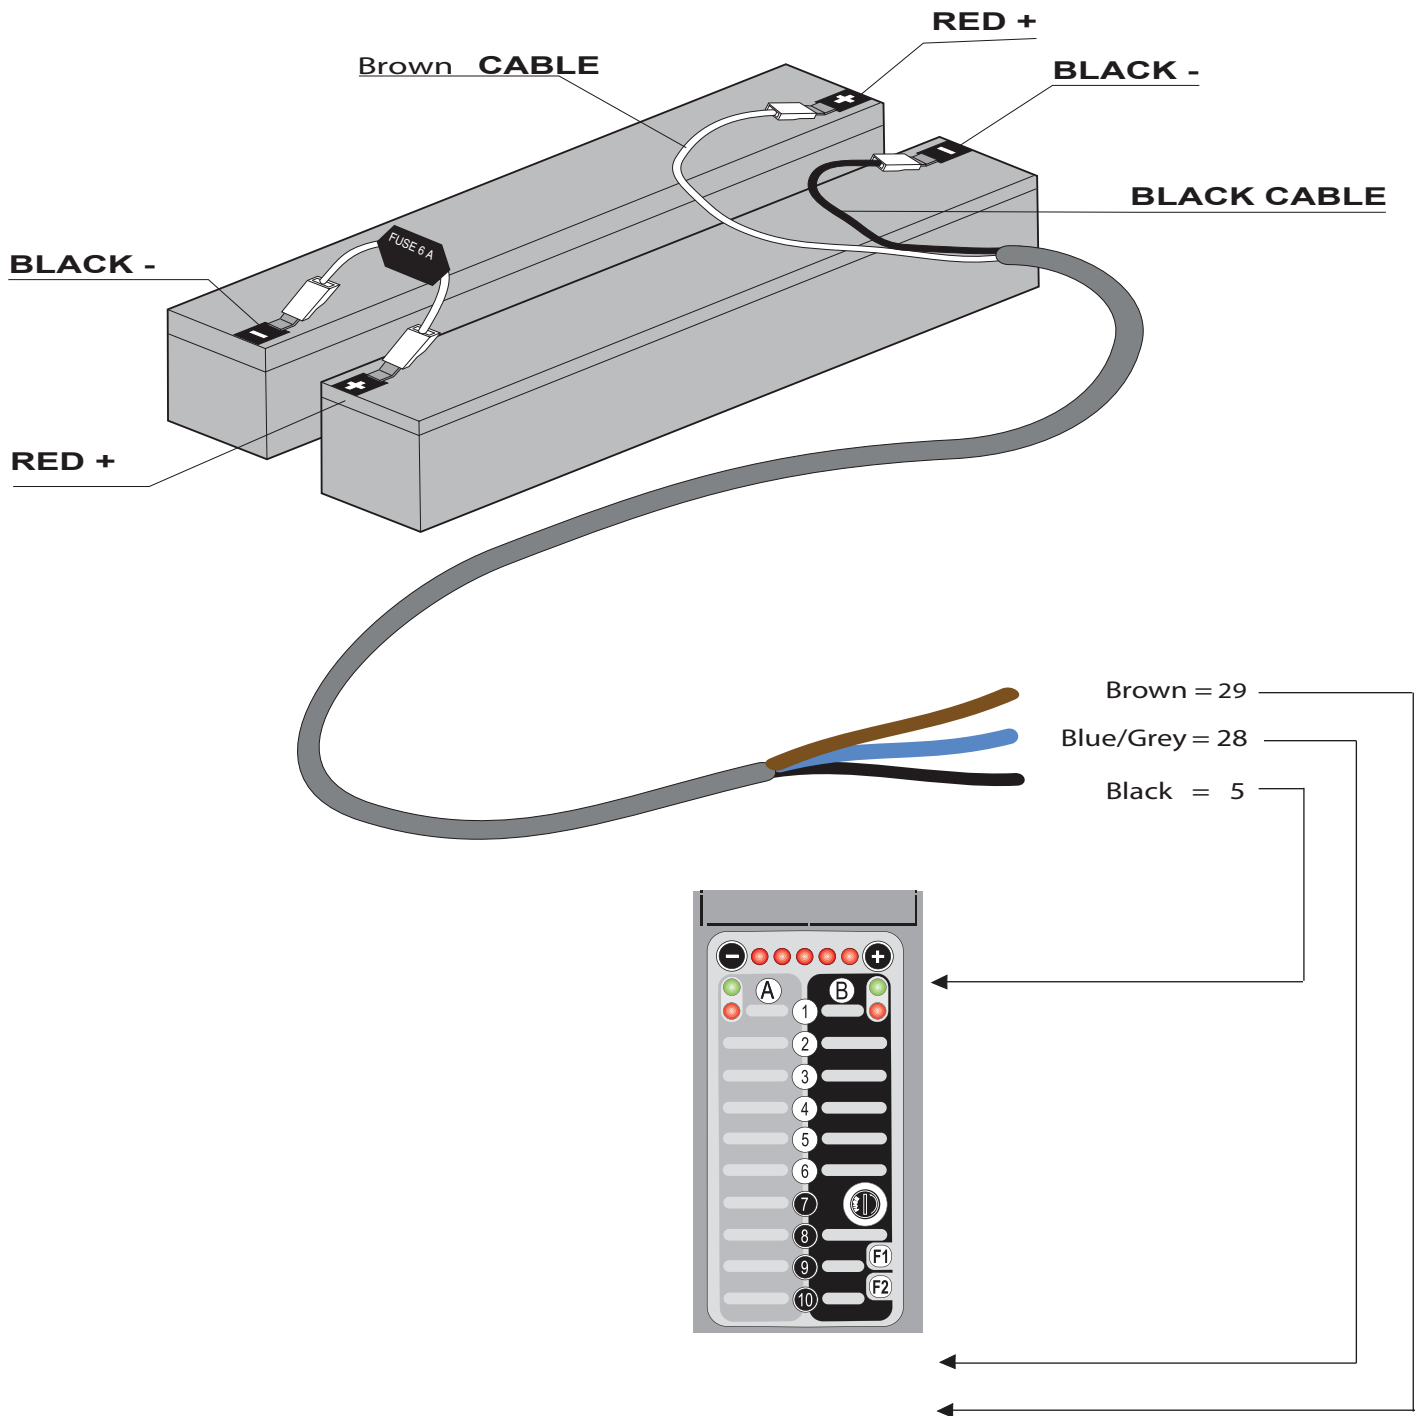


MODE OF OPERATION:

IN PRESENCE OF FAILURE:

Without any intervention, during a power outage, the photocells are not powered (default), consequently, the movement / actuation of the gate is allowed only in case of physical presence (a technician)

AGECH XL GE2A24/RG2A24

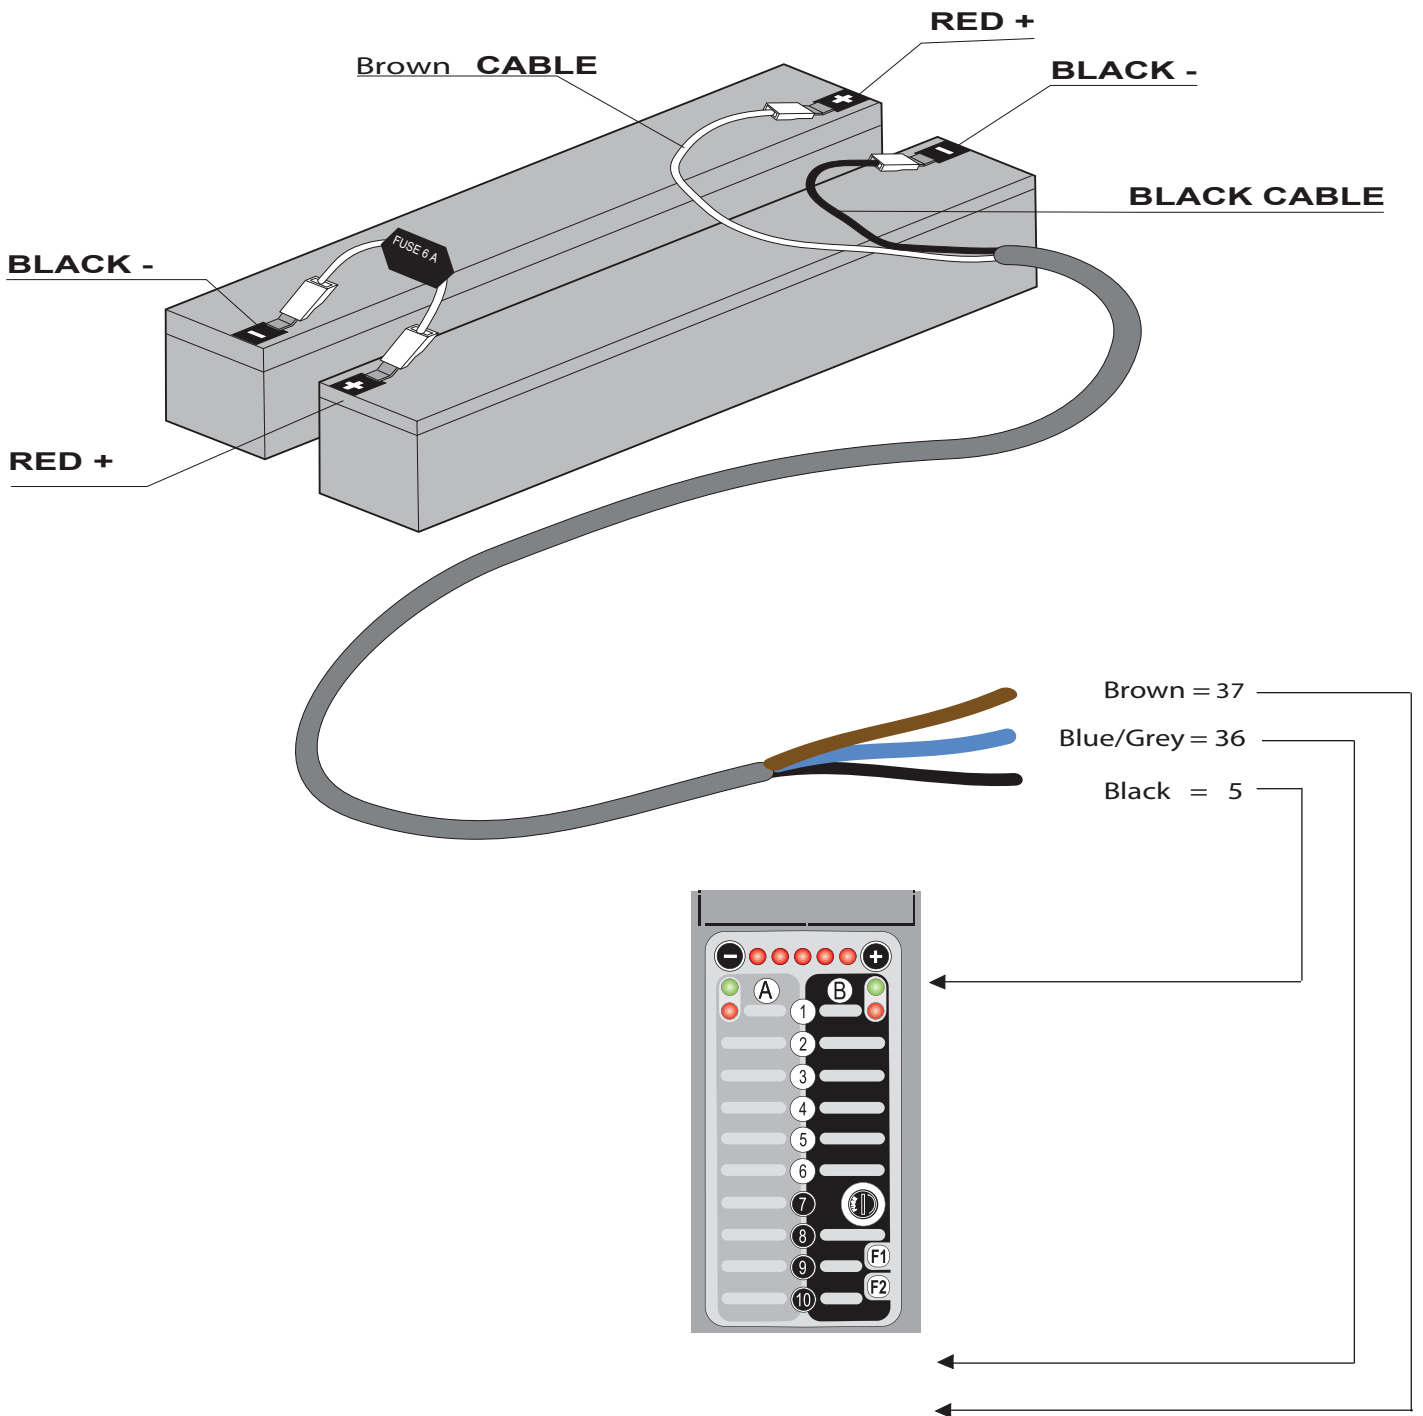

MODE OF OPERATION:

IN PRESENCE OF FAILURE:

Without any intervention, during a power outage, the photocells are not powered (default), consequently, the movement / actuation of the gate is allowed only in case of physical presence (a technician)